



# PSI, F.Y.I.

*Engineering... Training... and YOU*

## Headlines:

- **Florida Statute 633 Fire Prevention and Control**
- **Florida Rule 69A-48 Fire Alarm Systems**
- **Florida Rule 69A-46 Fire Suppression Systems**

## FIRE PROTECTION SERVICE TAG REQUIREMENTS

### Florida Statute 633 Fire Prevention and Control

The State of Florida has several laws which apply to the installation, service and maintenance of fire protection systems—both fire alarm and fire suppression systems.



Florida Statute 633 Fire Prevention and Control is the Florida law which governs all fire hazards.

**633.065:** All fire protection systems must be inspected, serviced, and maintained in accordance with NFPA standards.

**633.070:** Standard service tags are required on all fire protection systems

**633.082:** Fire protection systems shall be inspected per NFPA standards and the inspection report shall be provided to both the owner and the AHJ.

### Florida Rule 69A-48 Fire Alarm Systems

The State of Florida has further adopted several rules which serve to guide us in the application of specific fire protection systems.

Florida Rule 69A-48 Fire Alarm Systems is the Florida law with governs the installation, service, and maintenance of fire alarm systems.

nance of fire alarm systems.

#### 69A-48.006:

- All repairs shall be recorded by the repairing company in the system record log.
- Service report must be sent to AHJ within five business days.

- Drawings must be kept with the system record log.
- When work is performed, the device number shall be listed in the system record log.

## Upcoming Events!


- None scheduled at this time.

**Florida Rule 69A-48 Fire Alarm Systems (cont.)**

69A-48.006:

Fire Alarm Tag Specifications:

- Any color, except red—high contrast.
- Arranged as shown.
- Old tags must be removed.
- Contain the following information:
- Punched with standard 1/8” or 1/4” hole punch.
- Pressure sensitive label or tie-on type.
- Size apx. 2-1/2” x 5”.

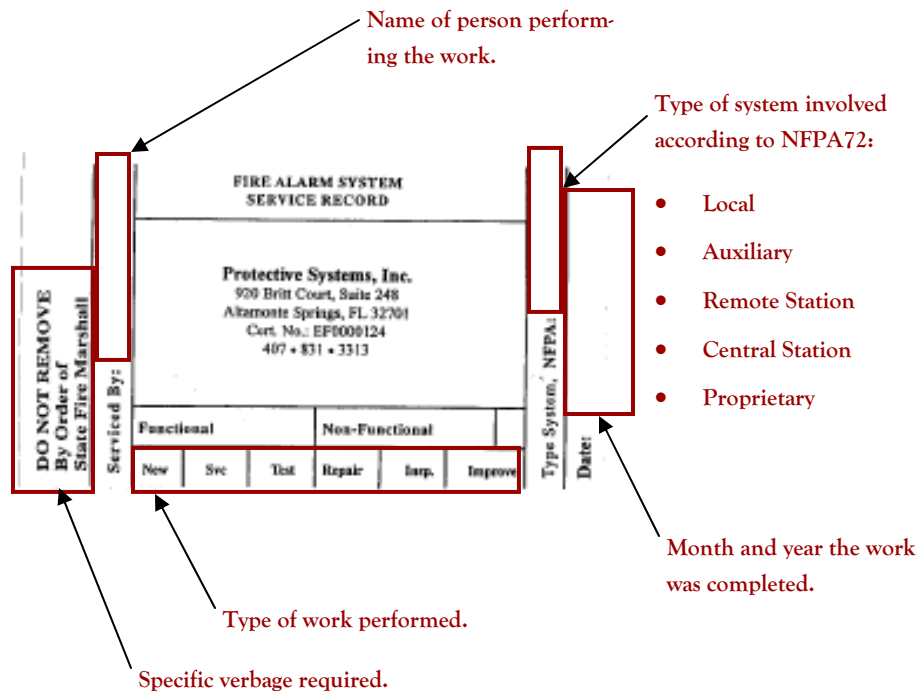

**Florida Rule 69A-46 Fire Suppression Systems**

Florida Rule 69A-46 Fire Suppression Systems is the Florida law with governs the installation, service, and maintenance of all types of fire suppression systems.

69A-46.41:

- All inspecting, testing, and maintenance service shall comply with the requirements of the applicable NFPA standard.
- Each system shall have a record tag of durable and weather resistant material placed on the riser or control device (solenoid).
- Inspection tags must be a minimum of 5 1/4” x 3 1/2” and a maximum of 7” x 4”.
- New tags must be attached to the riser is such a position as to permit convenient inspection and not more than 60” A.F.F.
- Inspection tags can only be removed by the designated fire protection inspector.

### Florida Rule 69A-46 Fire Suppression Systems

- **GREEN** tags shall be issued for all systems within compliance.
- **RED** tags shall be issued for all systems not in compliance with applicable NFPA standards.
- For systems that ARE OPERATIONAL but NOT IN COMPLIANCE, the building owner shall be notified by a copy of the inspection report within 30days.
- For systems that are NOT OPERATIONAL, the building owner, the occupant, and the AHJ must be notified within 24 hours of the inspection.
- Inspector shall complete in detail the inspection reports as required by the applicable NFPA standard.
- The inspection report shall include a detailed explanation of every deficiency .
- Contractor shall maintain all records of any fire protection system having been serviced.
- Records must be made available to the AHJ upon request.
- It is the owner's responsibility to maintain the fire protection system.
- Inspection tags must contain the following information:

**DO NOT REMOVE BY ORDER OF THE STATE FIRE MARSHAL**

**Protective Systems, Inc.**  
920 Britt Court, Suite 248  
Altamonte Springs, FL 32701  
800-626-6129

State Certificate #08793700011967

INSPECTION PERFORMED BY:  
NAME (PRINT) \_\_\_\_\_  
SIGNATURE \_\_\_\_\_  
NICET # \_\_\_\_\_  
CYLINDER SERIAL # \_\_\_\_\_

FACILITY NAME: \_\_\_\_\_  
FACILITY ADDRESS: \_\_\_\_\_

Monthly  New  Quarterly  Inspection  Semi-annual  Recharge  Annual  Repair

Affixing this tag shall not be construed to invalidate the owner's responsibility to maintain the system as provided in Section 633.082, F.S.

Clean Agent System  Foam System  Co2 System  Pre-Action System  Deluge System  Watermist  Dry Chemical System

DATE OF REPAIR: \_\_\_\_\_  
REPAIRED BY: (Signature) \_\_\_\_\_  
PRINT NAME: \_\_\_\_\_  
TYPE OF REPAIR: \_\_\_\_\_  
PERMIT NO. \_\_\_\_\_

DATE OF REPAIR: \_\_\_\_\_  
REPAIRED BY: (Signature) \_\_\_\_\_  
PRINT NAME: \_\_\_\_\_  
TYPE OF REPAIR: \_\_\_\_\_  
PERMIT NO. \_\_\_\_\_

DATE OF REPAIR: \_\_\_\_\_  
REPAIRED BY: (Signature) \_\_\_\_\_  
PRINT NAME: \_\_\_\_\_  
TYPE OF REPAIR: \_\_\_\_\_  
PERMIT NO. \_\_\_\_\_

## Today's

### References:

- Florida Statute 633.065
- Florida Statute 633.070
- Florida Statute 633.082
- Florida Rule 69A-46.041
- Florida Rule 69A-48.006

Protective Systems, Inc. places a high value on individual education. We are dedicated to providing ongoing training for our managers, designers, and technicians who are expected to maintain a minimum NICET II certification is fire alarm and/or fire special hazards.

As codes, applications and enforcements are continually changing, Protective Systems, Inc. feels it is important to highlight specific topics to provide clarification and encourage discussion.

Please forward all correspondence to [kim.nielsen@callpsi.com](mailto:kim.nielsen@callpsi.com)

### PSI, F.Y.I.

Editor, Kim Nielsen

#### Orlando

220 Springview Commerce Dr. #170  
DeBary, FL 32713  
Phone: 386-944-5820  
Fax: 386-668-0877  
Email: [kim.nielsen@callpsi.com](mailto:kim.nielsen@callpsi.com)

#### S. Florida

1719 NW 79th Ave.  
Doral, FL 33126

#### Tampa

5404 56th Commerce Park Blvd.  
Tampa FL 33619